


TAGE NO.	-
FEEDER NAME	-
CAPACITY	-
NUMBERING	<input type="checkbox"/> = FEEDER NO

LOP

MOTOR CONTROL CENTER

UNIT RELAY

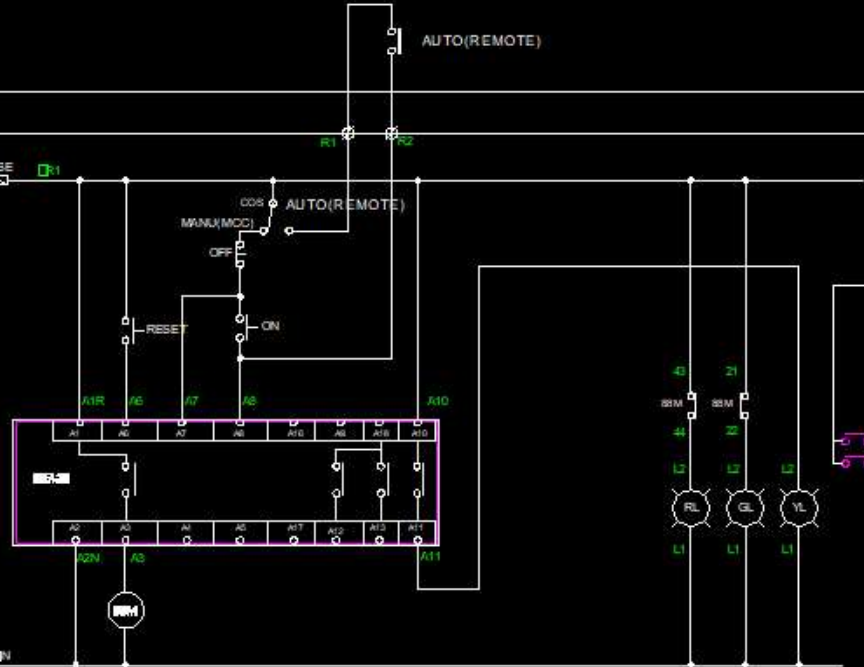

TIB NO	기호
A1	(R) (AC110-240V)
A2	(N)
A3	380V 3P-W (3P-W 380V)
A4	380V 3P-W (3P-W 380V)
A5	380V 3P-W (3P-W 380V)
A6	(R) = RESET, OFF, LOCK
A7	(R) = LOP, LOCAL
A8	(R) = AUTO, REMOTE, (R)
A9	(R) = (MANUAL/REMOTE) (R)
A10	FAULT OUT
A11	FAULT OUT
A12	(AUTO REMOTE OUT)
A13	(R) = (R) FAULT, (R) OUT
A14	(R) = 2CTIN
A15	(R) = 2CTIN
A16	(R) = (R) 100V (I) = 20mA
A17	(R) = (R) 100V (I) = 20mA
A18	(COM)



기호	기호	기호
A1-A2	A3-A4	A5-A6
A7-A8	A9-A10	A11-A12
A13-A14	A15-A16	A17-A18

FRONT DOOR

5							
4							
3							
2							
1							
0	ISSUED FOR APPROVAL						
REV.	DESCRIPTION	DATA	DRWN	DSGN	CHKD	APPD	

CUSTOMERS							
M제 커-200(직입기동+AUTO)							

TITLE	SEQUENCE DIAGRAM OF M제 커-200-IV						REV	0
SCALE								
DIMENSION	MM							
WORK NO	2015 - 01 - A001						SHEETS	
DWG NO	01							